

LEADIR –PS100

*Something Old – Something New*

Presented at the

*Thorium Energy Alliance Conference*

Chicago IL

2013 May 30 and 31

By

Ralph S. Hart

Engineering Manager

**Northern Nuclear Industries Incorporated**



*Something Old – Something New*

**LEADIR-PS** is an acronym for:

**LEAD**-cooled **I**ntegral **R**eactor - **P**assively **S**afe.

***Something Old:*** Graphite Moderator, TRISO fuel and Lead coolant, all with significant reactor operating experience.

***Something New:*** the novel combination of proven elements in an advanced thermal reactor.

*Something Old – Something New*

***LEADIR-PS100 has an output of 100 MW<sub>th</sub>***

- Initial market focus is the Canadian Arctic and Western Canadian Oil sands.
- The small LEADIR-PS100s, while meeting market demands, will serve as demonstration plants.
- The creep, crawl, walk, run approach is adopted.
- Future LEADIR-PS reactors may have larger capacity, higher temperature capability, operate on a Thorium fuel cycle.

## *Something Old – Something New*

### ***LEADIR-PS Design Requirements***

Comprehensive design requirements focused on safety, economics and minimizing development were defined which resulted in high level requirements including:

1. Production on a modern assembly line.
2. Capable of remote unattended operation, with 3000MW<sub>th</sub> minimum operated from a central facility.
3. Have maintenance and refuelling services provided by specialized crews deployed from central locations.
4. Have security and surveillance provided by existing or modestly enhanced organizations.
5. Facilitate siting within conventional facilities in populated areas (below large parking garages, etc.).

*Something Old – Something New*

***Why LEADIR-PS?***

- A pool type reactor employing a high boiling point coolant is necessary to meet the design requirements.
- Extensive studies of most prior reactors including the HTGR, the MSRE, and Hallam were completed.
- MSRs can potentially meet requirements but they have challenges requiring extensive development.
- The integration of Hallam and HTGR technologies utilizing  $^{208}\text{Pb}$  coolant offers a viable **near term** energy solution requiring minimal development.

*Something Old – Something New*

***Coolant Selection***

- Acceptable coolants identified are molten salt, lead ( $^{208}\text{Pb}$ ), and  $^{208}\text{Pb}$ -bismuth eutectic with melting points of 354 °C, 327 °C and 125 °C respectively.
- Bismuth is corrosive and yields Polonium, a neutron and alpha emitter, in a high neutron flux.
- Bismuth,  $^{208}\text{Pb}$  and molten salt have acceptably low thermal neutron capture cross-sections.
- $^{208}\text{Pb}$  does not react with water, graphite or air.
- $^{208}\text{Pb}$  avoids a requirement for an intermediate circuit.

## *Something Old – Something New*

### ***LEAD Coolant***

- Lead utilized in Russian Fast Breeders and Lead-Bismuth in Russian submarine reactors.
- $^{208}\text{Pb}$  has a very high boiling point (1750 °C).
- $^{208}\text{Pb}$  has excellent thermo-hydraulic characteristics, and high heat capacity.
- Lead is plentiful and low cost.
- Prior to use in LEADIR-PS100,
  - The lead is purified
  - The  $^{208}\text{Pb}$  isotope is separated, and
  - The  $^{208}\text{Pb}$  is conditioned to LEADIR-PS requirements

## *Something Old – Something New*

### *Graphite Moderator*


- Has a long history in reactor operation (MAGNOX, AGR, HTGR, RBMK, more).
- Has a strong negative reactivity temperature coefficient.
- Is an excellent and efficient moderator.
- Has a very high temperature capability.
- Has a high Heat Capacity.
- No reaction with  $^{208}\text{Pb}$  at high temperature.



## *Something Old – Something New*

### *TRISO Fuel*



- Dragon Project technology advanced by Germany and US.
- Main benefit is the retention of fission gas and radionuclides within the Silicon Carbide Barrier Layer.
- Maintains integrity to above 1600 °C
- Currently produced by Japan and China.

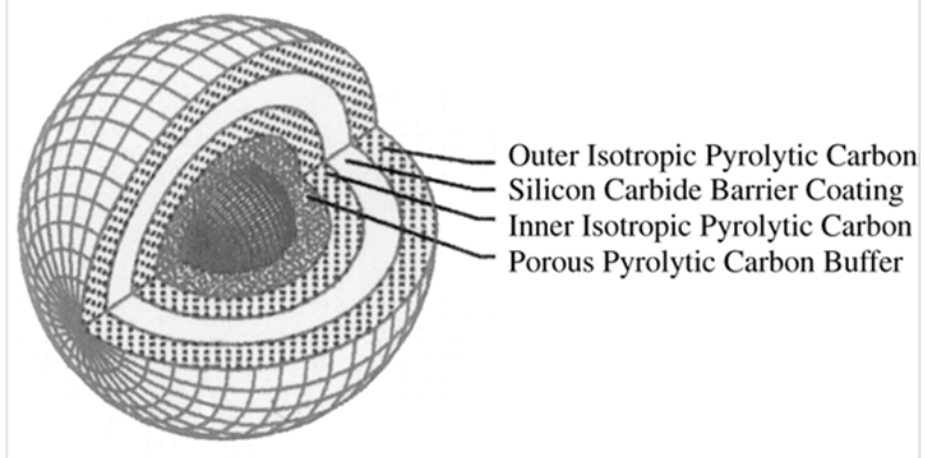

## *Something Old – Something New*

### *Reference Core*

- Prismatic: Fuel blocks contain TRISO Fuel and Coolant passages.
- Axial and radial Graphite reflector blocks.
- Fuel and reflector blocks are buoyant in  $^{208}\text{Pb}$ .
- Pebble Bed core has advantages for large LEADIR-PS reactors.

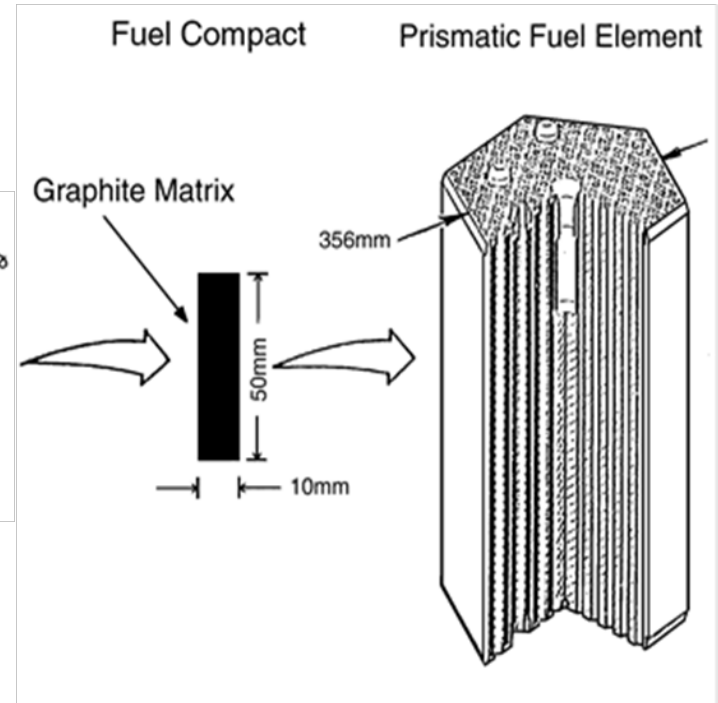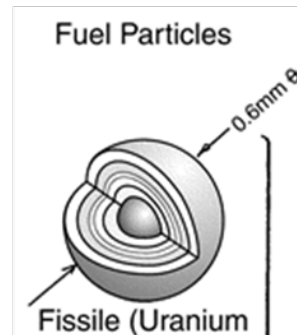

# LEADIR –PS100

## *Something Old – Something New*


### ***LEADIR-PS100***

### ***Reactor***

### ***Configuration***

Core Inlet - 360 °C

Core Outlet - 560 °C

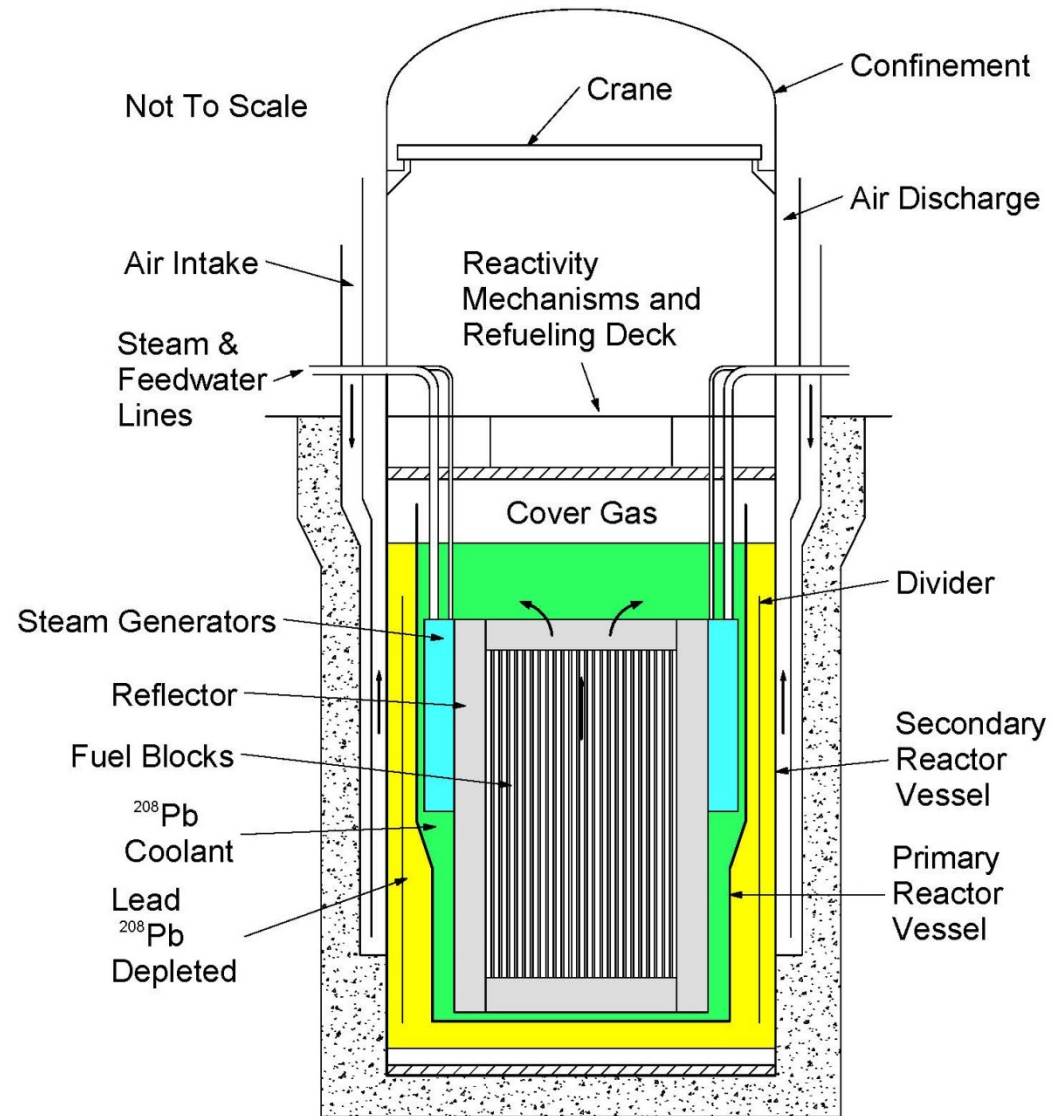

*Something Old – Something New****Reactor Control and Shutdown***

- Control rods & Shutdown Rods operate in the reflector.
- Control rod assemblies are driven in and out (electric stepping motors).
- Shutdown rods (SDRs) drop by gravity with initial spring assist (CANDU concept).
- Safety system initiation of SDRs is backed up by a passive initiation system.
- Shutdown via negative temperature reactivity coefficient as a last resort.

## *Something Old – Something New*

### *Safety Overview*

- **Lead Coolant:** high temperature capability and no chemical reaction with graphite, water or air.
- **Graphite Moderator:** provides inherent shutdown capability, high temperature & structural capability.
- **TRISO Fuel:** Radionuclide retention at high temperature.
- **Pool Configuration:** Avoids concerns over high energy pressure vessel rupture, simple, and relatively low cost .

*Something Old – Something New*

***Safety Overview Continued***

- **Passive Shutdown System:** SDRs drop by gravity, passive backup initiation.
- **Assurance of core submergence:** The core remains submerged in lead even if both the primary and secondary reactor vessels fail.
- **Passive decay heat removal:** Assured for all credible events for an indefinite period of time.

## *Something Old – Something New*

### *Challenges*

- Technical challenges can be met with reasonable effort and sound engineering.
- The difficult challenge is the Regulatory. Unless Regulatory bodies recognize and credit the features unique to small reactors such as LEADIR-PS100, commercialization will not be realized by any small reactor.
- Hence there must be a focus on communication with the Regulatory agencies (CNSC in Canada).

*Something Old – Something New*

*Summary*

LEADIR-PS100 meets safety and economic design requirements and provides a near term nuclear solution to target market energy demands.

*Something Old – Something New*

Meeting tomorrow's energy needs.



LEADIR –PS100

*Something Old – Something New*

*Thank You*